

CLASSIFICATION CONFIDENTIAL/CONTROL-US OFFICIALS ONLY
 INTELLIGENCE CENTRAL INTELLIGENCE AGENCY
 SECURITY INFORMATION
INFORMATION REPORT

REPORT NO. [REDACTED]

25X1A

CD NO.

COUNTRY USSR (Estonian SSR)

DATE DISTR. 4 Feb 1952

SUBJECT Power Plant in Kivioli

NO. OF PAGES 2

PLACE
ACQUIRED [REDACTED]

25X1A

NO. OF ENCLS. 1
(LISTED BELOW)DATE OF
INFO. [REDACTED]SUPPLEMENT TO
REPORT NO.

25X1X

REFERENCE COPY

DO NOT CIRCULATE

1. Location :

Three hundred meters west of the railroad station of Kivioli (27°03'E/
 59°22'N), Estonian SSR, north of the railroad line to Taps, and south
 of the road to Kivioli.
 For location see Annex.

2. Plant installations :

Having been destroyed during the war, the plant was reconstructed and
 newly equipped. The stone structure plant building has one smokestack,
 65 meters high, and two sheet-metal funnels, extending 3 meters above
 the roof. Oil slate dust was used for fueling. A railroad connection
 is available. Two turbines, one from General Electric, the other an old
 Russian make turbine, were being installed during the time of obser-
 vation. It was learned from Soviets that a third turbine which had not
 yet arrived was to be installed.

3. Work force :

About 30 to 40 laborers in the power plant.

4. Capacity :

One turbine General Electric 6,000 kws

One turbine of Soviet origin 3,000 kws

(The capacity was seen from inscriptions on the turbines.)

25X1A

CLASSIFICATION CONFIDENTIAL/CONTROL-US OFFICIALS ONLY

DISTRIBUTION

25X1A

25X1A

CONFIDENTIAL/CONTROL/US OFFICIALS ONLY

CENTRAL INTELLIGENCE AGENCY

-2-

The scheduled capacity of the third turbine was to be 15,000 kws, according to Soviet statements.

25X1A

Comment :

The reconstruction of the power plant in Fussi is reported for the first time.


1 Annex : Power Plant in Kivioli

CONFIDENTIAL/CONTROL/US OFFICIALS ONLY

Annex to

25X1A

Power Plant in Kivioli

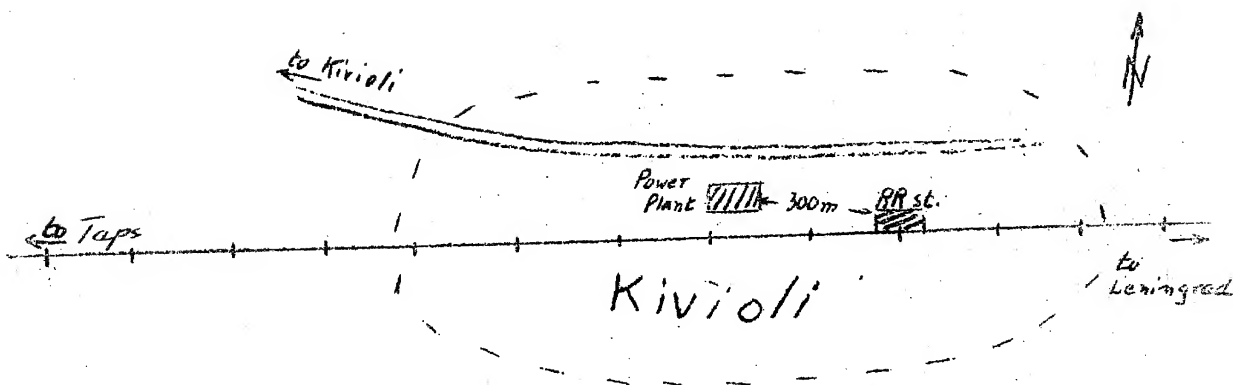

CONFIDENTIAL